


**DRINKING
WATER
SECURITY**

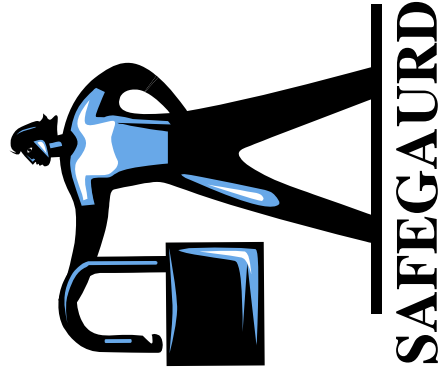

**SAFEGAURD
YOUR
DRINKING
WATER
SUPPLY**


**MIFFLINTOWN MUNICIPAL AUTHORITY
ENCOURAGES ALL OF OUR EMPLOYEES
AND CUSTOMERS TO BECOME
SECURITY CONSCIOUS AND ASSIST IN
PROTECTING OUR DRINKING WATER
RESOURCES AND INFRASTRUCTURE.**

**FOR EMERGENCIES OR TO REPORT
SUSPICIOUS ACTIVITY:**

717-436-2342
WATER OFFICE

MIFFLINTOWN MUNICIPAL AUTHORITY
POST OFFICE BOX 36
259 WATER COMPANY RD.
MIFFLINTOWN, PA 17059

Este informe contiene información muy importante sobre su agua de beber. Tradúzcalo o hable con alguien que lo entienda bien. (This report contains very important information about your drinking water. Translate it, or speak to someone who understands it.)

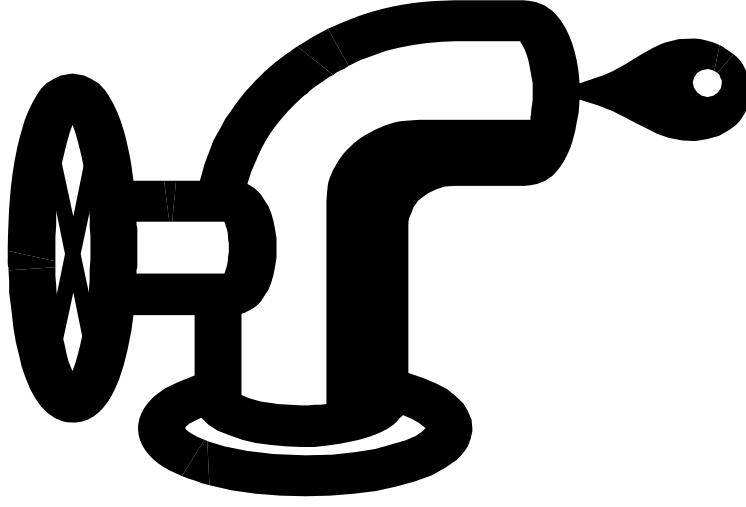

**MIFFLINTOWN MUNICIPAL
AUTHORITY**

**PO BOX 36
259 WATER COMPANY RD.
MIFFLINTOWN, PA 17059
717-436-2342**

**2011
CONSUMER CONFIDENCE
REPORT
&
WATER QUALITY
REPORT**

PWSID# 4340008

www.mifflintownwater.com

A SPECIAL MESSAGE FOR PEOPLE WITH SEVERLY WEAKENED IMMUNE SYSTEMS

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. The **Environmental Protection Agency (EPA)** and **The Centers for Disease Control and Prevention** guidelines on appropriate means to lessen risk of infection by **Cryptosporidium** and other microbial contaminants are available from the **Safe Drinking Water Hotline at (800)-426-4791**.

FOR MORE INFORMATION, PLEASE CONTACT:

- Your Doctor or other healthcare provider.
- Centers for Disease Control and Prevention at (800)-342-2437; or on-line at www.cdc.gov
- United States Environmental Protection Agency's Drinking Water Hotline at (800)-426-4791
- Pennsylvania Department of Environmental Protection on-line at www.dep.state.pa.us

MIFFLINTOWN MUNICIPAL AUTHORITY

SOURCE WATER INFORMATION

MIFFLINTOWN MUNICIPAL AUTHORITY WATER TREATMENT PLANT
PWSID # 4340008

Water Sources: Surface Water (Raw) Clearview Reservoir (Licking Creek) Reservoir Capacity: 66 Million Gallons
Juniata River Intake

Treatment Plant Capacity: 1008000 Gallons per Day
2011 Average Daily Water Use: 582,768 Gallons per Day

Water Source: Ground Water Macedonia Well
2011 : Macedonia Well were not used.

SOURCE WATER ASSESSMENTS

In 2004 the Pennsylvania Department of Environmental Protection completed a Source Water Assessment of the Macedonia Well and Clearview Reservoir (Licking Creek). The assessments found that Macedonia Well is a low risk ground water source not susceptible to contamination because the well meets DEP construction standards and has a good raw water quality. Clearview Reservoir (Licking Creek) is a surface water source and was assessed as a high risk surface water source. Surface water sources are more susceptible to accidental spills along roadways, releases of raw and/or under treated sewage, and storm water runoff developed and/or agricultural areas. Summary reports of the 2004 Source Water Assessment are available by writing to or contacting:

**Mifflintown Municipal Authority
Post Office Box 36
259 Water Company Rd.
Mifflintown, PA 17059
717-436-2342**

or at www.dep.state.pa.us (Keyword: "DEP source water")

If you have any questions about this report or concerning your water utility, please contact Mike Robinson, Manager at 717-436-2342. We want our customers to be informed about their water utility. If you would like to attend any one of our regularly scheduled meetings, they are held on the fourth Monday of January, March, May, July, September, and November at 7:00 pm in the office of the Water Treatment Plant located at 259 Water Company Road, Mifflintown, PA 17059.



MIFFLINTOWN MUNICIPAL AUTHORITY

Dear Customer:

As of January 1, 2012 the Mifflintown Municipal Authority will implement a new rate increase for all customers.

The quarterly rate structure base rate will go from \$64.08 to \$69.26 for zero to 5,000 gallons of usage and any usage over 5,000 gallons will remain at \$6.97 per 1,000 gallons.

The monthly rate structure base rate will go from \$21.36 to \$23.09 for zero to 1,667 gallons of usage and any usage over 1,667 gallons will remain at \$6.97 per 1,000 gallons.

We now offer the convenience of online and credit card payments. For secure online payments go to our company website at <http://www.mifflintownwater.com/index.html> and click on the MunicIPAY tab along the left side of page.

Payments can still be made at the following banks: First National Bank of Mifflintown, Juniata Valley Bank and First National Bank of Pennsylvania.

Credit card payments can be made at the Authority office between 8:30AM and 3:30PM Monday through Friday.

Payments can also be mailed to our office at P.O. Box 36, Mifflintown, PA 17059

If you have any questions regarding this matter, please contact the office at 717-436-2342.



Owners and Renters on the Mifflintown Municipal Authority water system

To better assist in public notifications (i.e., flushing, water main breaks and water outages), the Authority is asking customers to provide a phone number that can be used for these notices. You can enter your phone number into the Authority database from the Authority website at <http://www.mifflintownwater.com/index.html> by clicking on the Swift 911 Notification link on the left side of web page.

On this page enter necessary information.



In the spring of 2011 the Mifflintown Municipal Authority joined the AWWA's Partnership for Safe Drinking Water. The Partnership's mission is to improve the quality of drinking water delivered to customers of public water supplies by optimizing system operations. **The Partnership encourages and assists United States water suppliers to voluntarily enhance their water systems performance, for greater control of Cryptosporidium, Giardia and other microbial contaminants.**

We sampled our entry points on January 23, 2012. The following table shows the MCL, MCLG and results.

The 21 Regulated VOCs			
For Entry point #101	MCL	MCLG	01/23/2012
1,1,1-Trichloroethane	200	200	<.5
1,1,2-Trichloroethane	5	3	<.5
1,1-Dichloroethene			<.5
1,2,4-Trichlorobenzene			<.5
1,2-Dichlorobenzene	600	600	<.5
1,2-Dichloroethane	5	0	<.5
1,2-Dichloropropane	5	0	<.5
1,4-Dichlorobenzene	75	75	<.5
Benzene	5	0	<.5
Carbon Tetrachloride	5	0	<.5
Chlorobenzene	100	100	<.5
cis-1,2-Dichloroethene	70	70	<.5
Ethylbenzene	700	700	<.5
Methylene Chloride			<.5
Styrene	100	100	<.5
Tetrachloroethene	5	0	<.5
Toluene	1	1	<.0005
Total Xylenes	10	10	<.0015
trans-1,2-Dichloroethene	100	100	<.5
Trichloroethene	5	0	<.5
Vinyl chloride	2	0	<.5
For Entry point #102	MCL	MCLG	01/23/2012
1,1,1-Trichloroethane	200	200	<.5
1,1,2-Trichloroethane	5	3	<.5
1,1-Dichloroethene			<.5
1,2,4-Trichlorobenzene			<.5
1,2-Dichlorobenzene	600	600	<.5
1,2-Dichloroethane	5	0	<.5
1,2-Dichloropropane	5	0	<.5
1,4-Dichlorobenzene	75	75	<.5
Benzene	5	0	<.5
Carbon Tetrachloride	5	0	<.5
Chlorobenzene	100	100	<.5
cis-1,2-Dichloroethene	70	70	<.5
Ethylbenzene	700	700	<.5
Methylene Chloride			<.5
Styrene	100	100	<.5
Tetrachloroethene	5	0	<.5
Toluene	1	1	<.0005
Total Xylenes	10	10	<.0015
trans-1,2-Dichloroethene	100	100	<.5
Trichloroethene	5	0	<.5
Vinyl chloride	2	0	<.5

Entry point # 101 is from Clearview Reservoir. Entry point # 102 is from Macedonia wells. The results show that no value is above the MCL or MCLG. These tests will be repeated later this year.

MIFFLINTOWN MUNICIPAL AUTHORITY 2011 WATER QUALITY REPORT

The Mifflintown Municipal Authority (MMA) is committed to providing our customers with a reliable and affordable supply of high-quality drinking water. We test our water using sophisticated equipment and advanced analytical procedures. This annual "Consumer Confidence Report," required by the Safe Drinking Water Act, tells you where your water comes from, what our testing shows about it, and other things you should know about drinking water.

AN EXPLANATION OF THE WATER-QUALITY DATA TABLE

The table shows the results of our water-quality analyses. Every regulated contaminant that we detected in our water, even in the minutest traces, is listed here. The table contains the name of each substance, the highest level allowed by regulation (MCL), the ideal goals for public health, the amount detected, the major source of the contaminants, footnotes explaining the words and abbreviations used in the table. Many tests were conducted for other parameters including trace metals, radioactive particles, pesticides, herbicides, and numerous organic chemicals such as industrial wastes and solvents.

IMPORTANT DEFINITIONS

Maximum Contaminant Level or MCL: The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology.

Maximum Contaminant Level Goal or MCLG: The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

HEALTH INFORMATION

Drinking Water, including bottled water, may reasonably be expected to contain small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the **Environmental Protection Agency's Safe Drinking Water Hotline (800)-426-4791**.

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. Mifflintown Municipal Authority is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you *may* wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at <http://www.epa.gov/safewater/lead>

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and radioactive material, and can pick up substances resulting from the presence of animals or from human activity. Contaminants that may be present in source water include:

- Microbial contaminants, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife
- Inorganic contaminants, such as salts and metals, which can be naturally occurring or result from urban storm runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.
- Pesticides and herbicides, which may come from a variety of sources such as agriculture, storm water runoff, and residential uses.
- Organic chemical contaminants, including synthetic and volatile organics, which are by-products of industrial processes and petroleum production, and can, also, come from gas stations, urban storm water runoff and septic systems.
- Radioactive contaminants, which can be naturally occurring or be the result of oil and gas production and mining activities.

To ensure that tap water to drink, EPA prescribes regulations which limit the amount of certain contaminants in water provided by public water systems. FDA regulations establish limits for contaminants in bottles water which must provide the same protection for public health.

If you have any questions or comments regarding this report, please call the Mifflintown Municipal Authority at 717-436-2342 or e-mail at mmawater@embarqmail.com

MIFFLINTOWN MUNICIPAL AUTHORITY 2011 WATER QUALITY REPORT

CONTAMINANT	UNIT	MCL	MCLG	DATE TESTED	DETECTED LEVEL	VIOLATION
INORGANIC CHEMICALS						
Copper	CCRunits	1.3	1.3	2010	0.11000 Zero samples over MCL	NO
Lead	CCRunits	15	0	2010	14 Zero samples over MCL	NO
Nitrate	CCR units	10	10	2011	<0.5* <0.5**	NO
Nitrite	CCR units	1	1	2011	<0.2* <0.2**	NO
Barium	CCR units	2	2	2011	2*	NO
Arsenic	CCR units	10	0	2011	ND* <3**	NO
Asbestos	CCR units	7	7	2011	ND*	NO
Cadmium	CCR units	5	5	2011	ND*	NO
Chromium	CCR units	100	100	2011	ND*	NO
Cyanide (free)	CCR units	200	200	2011	ND*	NO
Fluoride	CCR units	2	2	2011	ND*	NO
Mercury	CCR units	2	2	2011	ND*	NO
Nickel	CCR units	1	0	2011	ND*	NO
Selenium	CCR units	50	50	2011	ND*	NO
Antimony	CCR units	6	6	2011	ND*	NO
Beryllium	CCR units	4	4	2011	ND*	NO
Nitrate	CCR units	10	10	2011	<0.5* <0.5**	NO
Nitrate	CCR units	10	10	2011	<0.5* <0.5**	NO
Thallium	CCR units	2	.5	2011	ND*	NO
Uranium		30	0	2011	<0.009* <2.06**	NO
Entry Point Disinfectant Residual					MRDL	
Entry Point	mg/L	4		8/29/2011	1.98	NO
Minimum Cl2 Residual	mg/L	.2		7/13/2011	.92	NO
Distribution	mg/L	.2		7/5/2011	.61	NO
Total Organic Carbon (TOC)		Range of % Removal Required 35.0%		Quarterly 2011	Range of % removal achieved 46.7%- 60.4%	NO
ORGANIC CHEMICALS						
Haloacetic Acids (Five)	CCR units	60	0	2011	21	NO
Trihalomethanes	CCR units	80	0	2011	25	NO
MICROBIOLOGICAL						
Bacteria		5% of monthly samples are positive		2011	0 samples	NO
Turbidity	NTUs	1 0.30	0.10 0.10	10/2/2011 2011	.093 100% samples <0.30	NO NO

VOLATILE ORGANIC CHEMICALS (VOCs)						
21 Primary Contaminants	CCR units	Ranges 10.0 – 2		2010	<0.5* <0.5**	YES
SYNTHETIC ORGANIC CHEMICALS (SOCs)						
Dalapon (SOC)	CCR units	200	200	2011	ND* ND**	NO
+Di (2-Ethyl) Phthalate (SOC)	CCR units	6	0	2011	ND* ND**	NO
Endrin	CCR units	2	2	2011	ND* ND**	NO
Lindane	CCR units	200	200	2011	ND* ND**	NO
Methoxychlor	CCR units	40	40	2011	ND* ND**	NO
Toxaphene	CCR units	3	0	2011	ND* ND**	NO
Diquat	CCR units	20	20	2011	ND* ND**	NO
Endothall	CCR units	100	100	2011	ND* ND**	NO
Glyphosate	CCR units	700	700	2011	ND* ND**	NO
Di(2-ethylhexyl) adipate	CCR units	400	400	2011	ND* ND**	NO
Oxamyl [Vydate]	CCR units	200	200	2011	ND* ND**	NO
Simazine	CCR units	4	4	2011	ND* ND**	NO
Picloram	CCR units	500	500	2011	ND* ND**	NO
Dinoseb	CCR units	7	7	2011	ND* ND**	NO
Hexachlorocyclopentadiene	CCR units	50	50	2011	ND* ND**	NO
Carbofuran	CCR units	40	40	2011	ND* ND**	NO
Atrazine	CCR units	3	3	2011	ND* ND**	NO
Alachlor	CCR units	2	0	2011	ND* ND**	NO
Dioxin [2,3,7,8-TCDD]	CCR units	30	0	2011	ND* ND**	NO
Heptachlor	CCR units	400	0	2011	ND* ND**	NO
Heptachlor epoxide	CCR units	200	0	2011	ND* ND**	NO
2,4-D	CCR units	70	70	2011	ND* ND**	NO
2,4,5-TP [Silvex]	CCR units	50	50	2011	ND* ND**	NO
Hexachlorobenzene	CCR units	1	0	2011	ND* ND**	NO
Benzo[a]pyrene	CCR units	200	0	2011	ND* ND**	NO
Pentachlorophenol	CCR units	1	0	2011	ND* ND**	NO
PCBs [Polychlorinated biphenyls]	CCR units	500	0	2011	ND* ND**	NO
1,2-Dibromo-3-chloropropane (DBCP)	CCR units	5	0	2011	ND* ND**	NO
Ethylene dibromide	CCR units	50	0	2011	ND* ND**	NO
Chlordane	CCR units	2	0	2011	ND* ND**	NO

WATER QUALITY TABLE FOOTNOTES

* Clearview Reservoir (Licking Creek), Juniata River

** Macedonia Well

*** Violations issued in 2011

	CONTAMINANT ID	CONTAMINANT TYPE	VIOLATION	VIOLATION ID	ENTRY POINT LOCATION	PERIOD BEGIN DATE	FISCAL YEAR
Ran on 03/21/2011 but not reported by Microbac Labs	Fluoride	1025	PUBLICNOTIFICATIONTIER3-N3	8592	101	01/01/2011	2011
21 Regulated VOCs	21 Primary Contaminants	2378-2996	PUBLICNOTIFICATIONTIER3-N3	8593-8612	101	01/01/2011	2011
21 Regulated VOCs	21 Primary Contaminants	2378-2996	PUBLICNOTIFICATIONTIER3-N3	8613-8628	102	01/01/2011	2011

DRINKING WATER DISINFECTION

Chlorine acts as a powerful disinfection agent when used either on its own or as sodium hypochlorite (bleach). Added to water in minute quantities, it quickly kills bacteria and other microbes. Chlorine has the major advantage of ensuring clean water right up to the tap, whereas the action of other disinfectants - such as ozone, ultraviolet light and ultra filtration - is only temporary. In addition to purifying water, chlorine helps remove tastes and odors, controls the growth of slime and algae in main pipes and storage tanks, and helps to remove unwanted nitrogen compounds from water.

MMA uses chlorine gas to treat water from Clearview Reservoir, Juniata River and sodium hypochlorite (bleach) to treat water from Macedonia Well.

FLUORIDATION

Mifflintown Municipal Authority does not add fluoride to your drinking water. Fluoride is not added due to the fact that it is expensive, difficult to handle because of its toxicity, and improved dental hygienic products and procedures.